



JOHN HARDY POWER SUPPLY

4/25/94

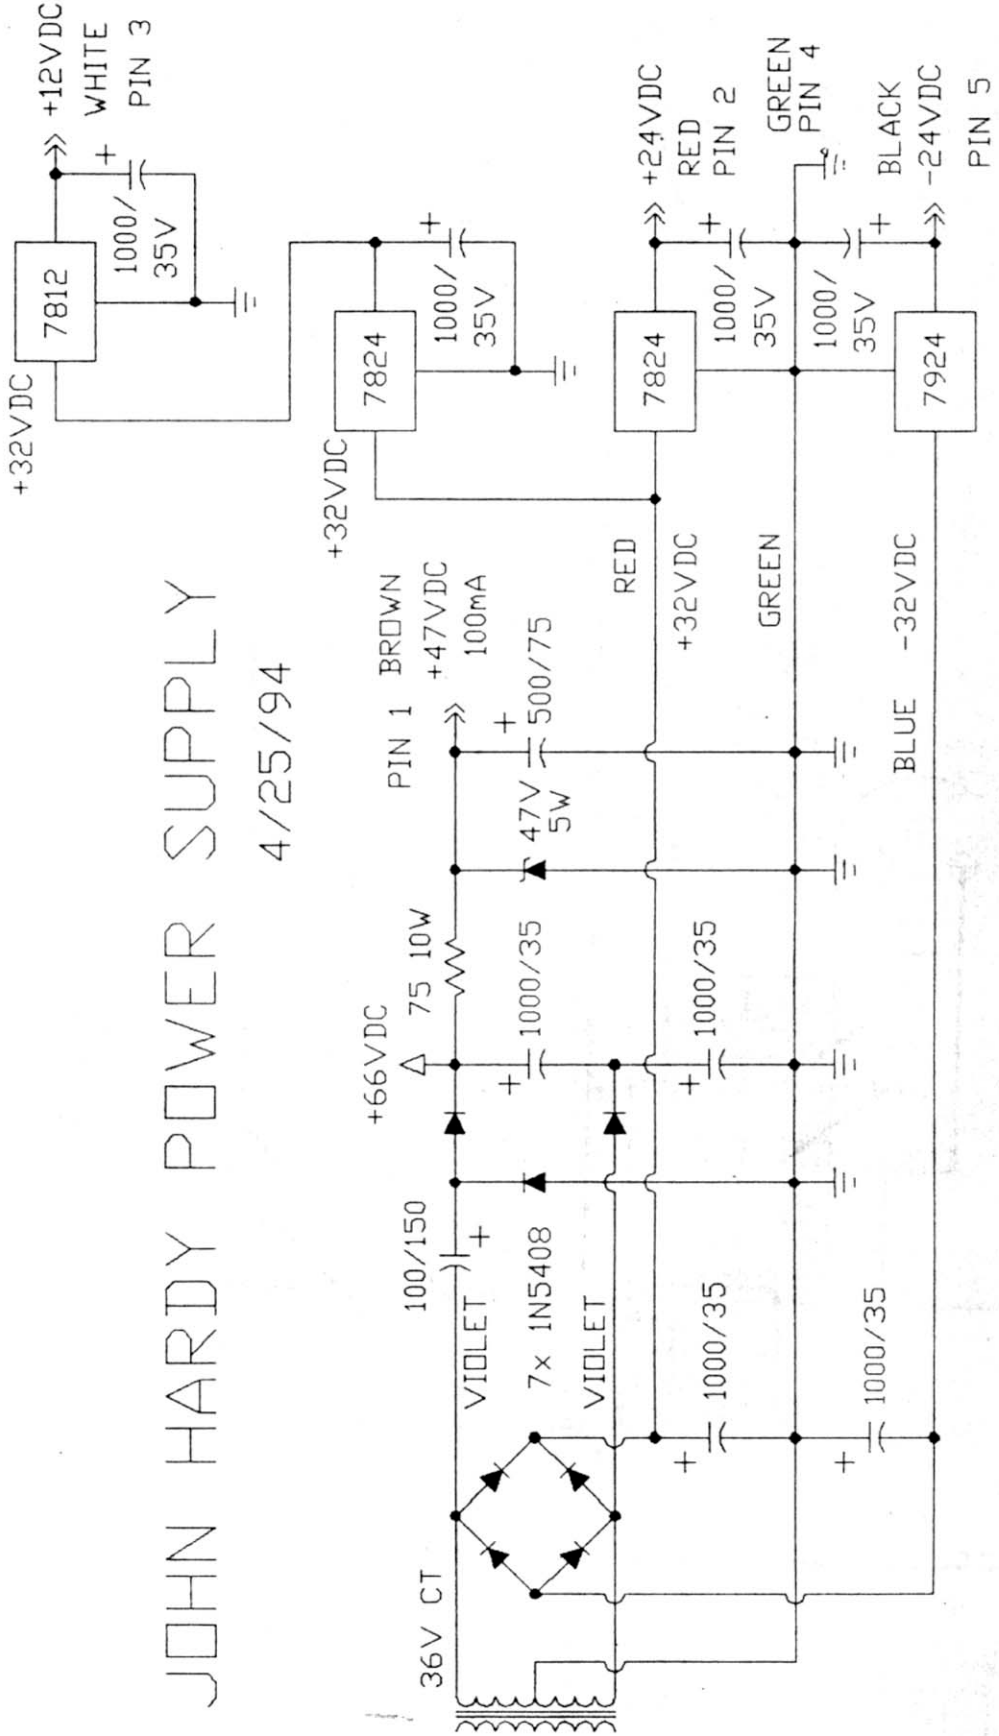

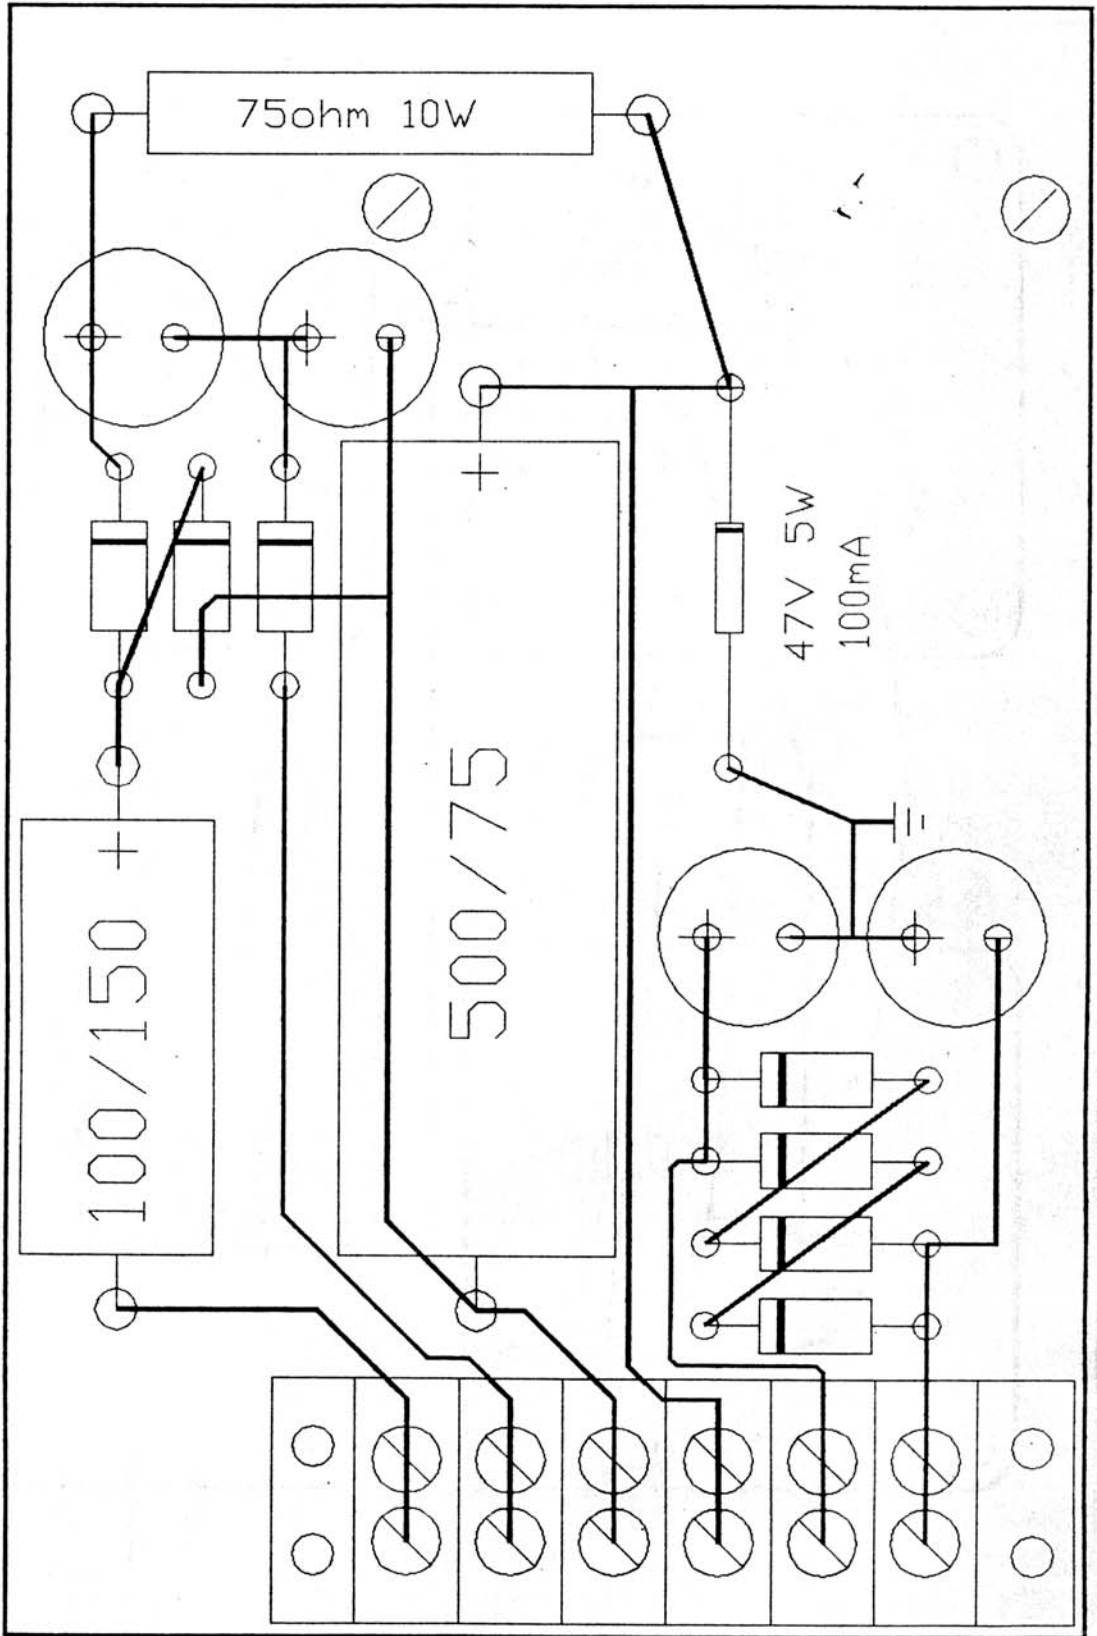

AC


AC

CT/GND

+48

+28V

+28V

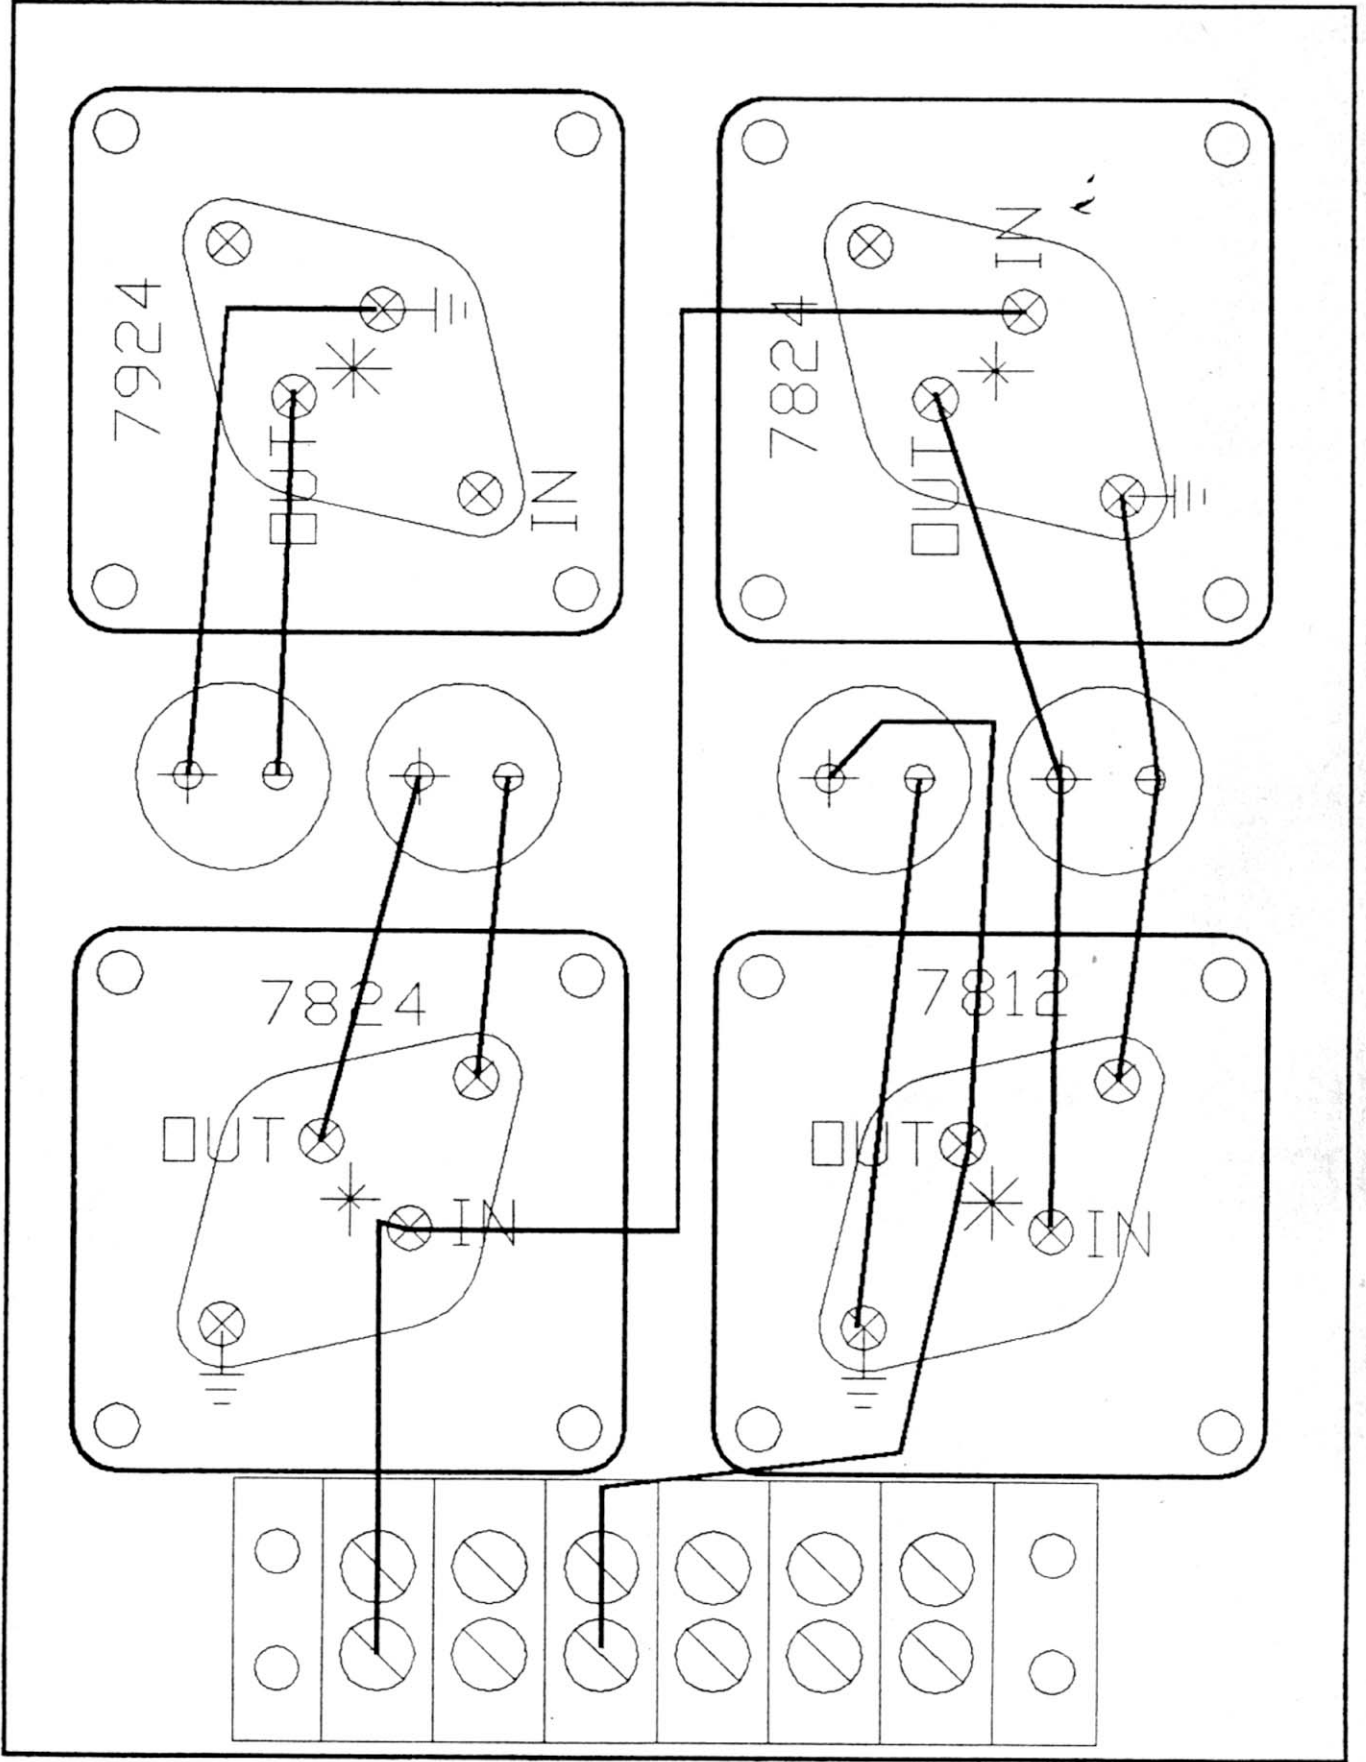

+30
+24
+12
GND
-24
-30